Scope SV-954

Describes Minimum Clearance From Primary Power Pole With Secondary Underbuild To A Structure

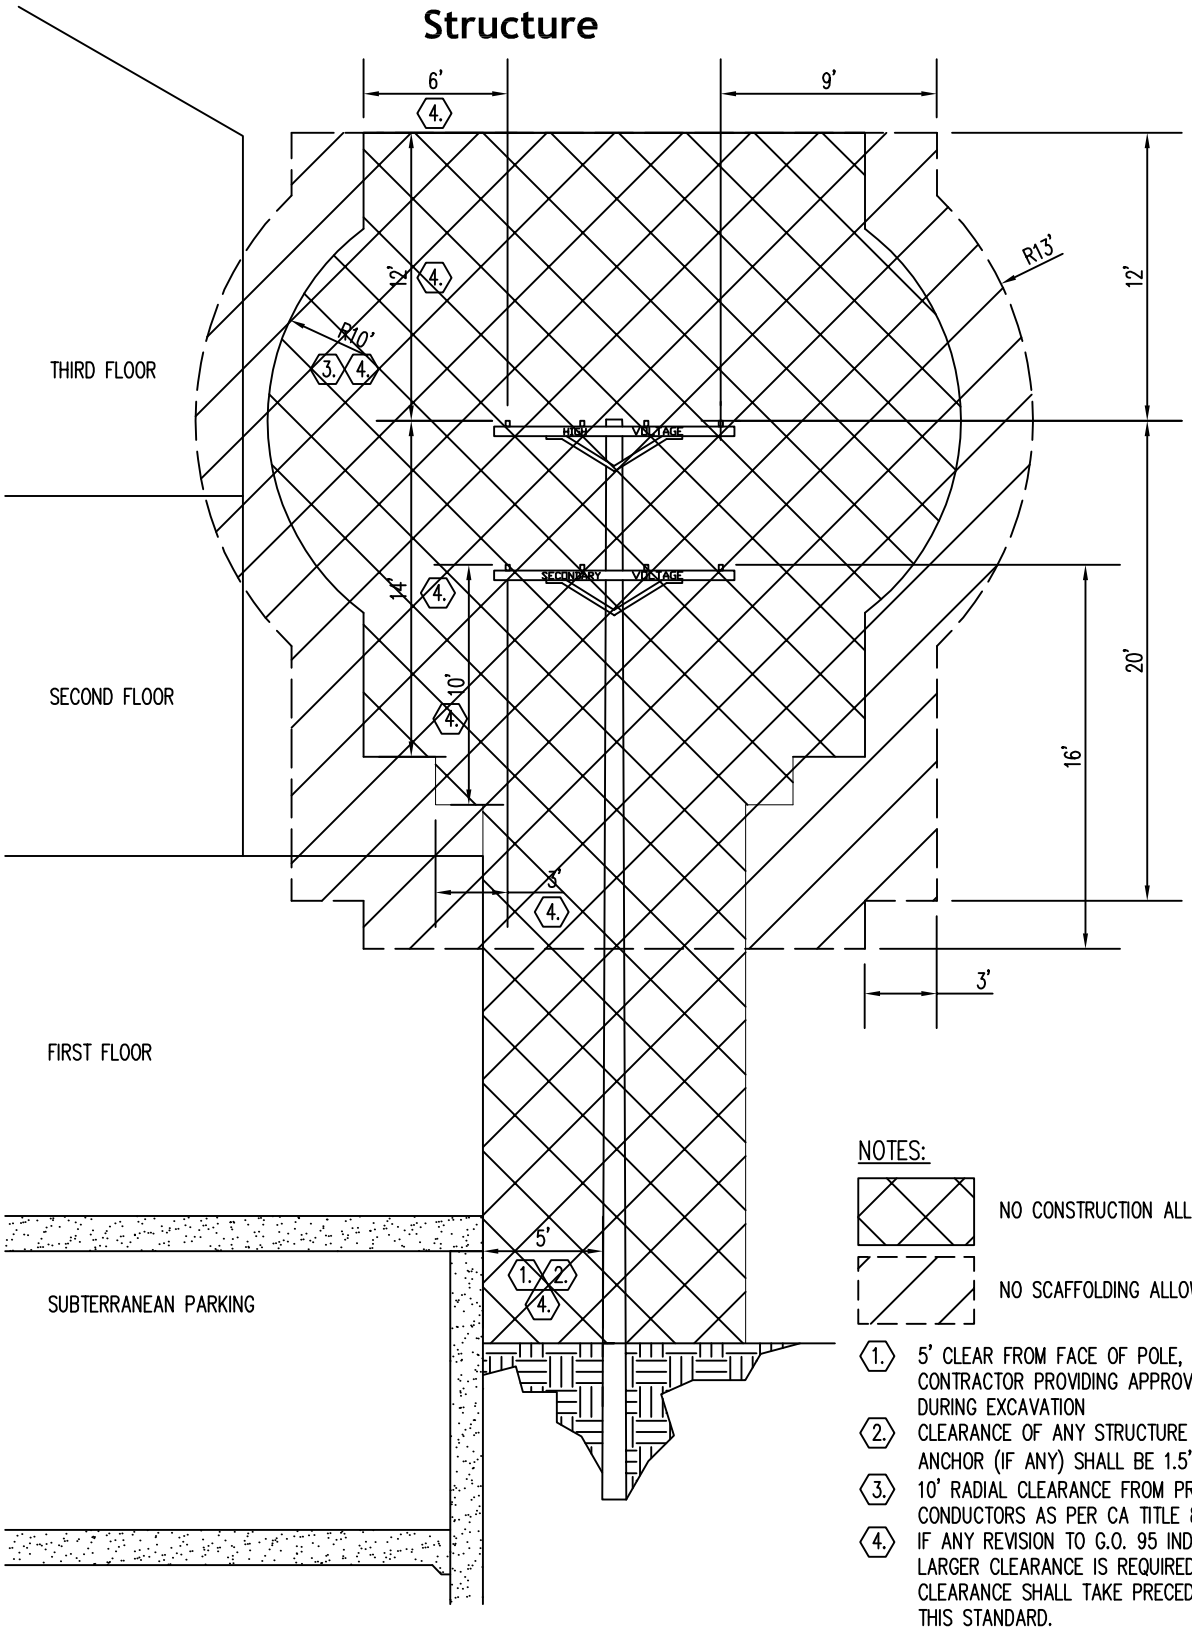

NOTES:

NO CONSTRUCTION ALLOWED

NO SCAFFOLDING ALLOWED

1. 5' CLEAR FROM FACE OF POLE, WITH CONTRACTOR PROVIDING APPROVED SHORING DURING EXCAVATION
2. CLEARANCE OF ANY STRUCTURE TO THE ANCHOR (IF ANY) SHALL BE 1.5'
3. 10' RADIAL CLEARANCE FROM PRIMARY CONDUCTORS AS PER CA TITLE 8.
4. IF ANY REVISION TO G.O. 95 INDICATES A LARGER CLEARANCE IS REQUIRED, THE G.O. 95 CLEARANCE SHALL TAKE PRECEDENCE OVER THIS STANDARD.
5. DISTANCES ARE TYPICAL FOR BOTH SIDES OF POWER POLE

Rev #	Date	Drawn	Checked	Approved
1	3-29-18	JN	KH	
2				
3				
4				

PASADENA Water&Power

Drawn	SV	2-13-07
Chk'd		7-11-07
Apv'd		7-11-07

Electric Distribution Standards

Overhead Conductors And Power Pole Minimum Clearances

OH

SV-954

SHEET 3 OF 3

FILENAME: